

Subject: Adding Upfitter Switches (9L7)
Models Years Affected: 2024
Models Affected: Zevo 400/600
Origination Date: September 24, 2023
Revision Date: N/A

ADVISORY:

Condition/Concern:

Some Customers or Upfitters have inquired on how to add Upfitter Switch (9L7) option to a Brightdrop Zevo 400/600. MY24 and beyond will have two fused power feeds for upfitter use. RPO 9L7 will provide the following:


- **Two fused, relay-controlled output circuits (30a and 10a).** The default factory wiring provides for continuous power if the control switch is 'ON.' [Power does not go 'OFF' with key 'OFF.']. Upfitter equipment loads can be directly attached to these wires. Equipment ground wires are not provided.
- **Two user utilized relay control circuits** – Customer/Upfitter to provide V+ input for relay activation. Switches are not included. The ignition or RUN circuit could be utilized for the activation power for these relays the upfitter/customer may want active only when in RUN.
- **One 10 amp fused Ignition (Run Mode) Circuit.**
- Easy in-cab access to the Blunt cut wires [located near the Park Brake].
- The power source for the Two fused relay-controlled output circuits is from the 12v Battery. This arrangement protects from the dangers of the High Volt system.
- An additional schematic shows how to accomplish an ignition switched arrangement.

Note:

An additional schematic shows how to accomplish an ignition switched arrangement.

Repair/Recommendation:


**Upfitter Electrical Wiring Provisions – 9L7
Provisional Blunt cuts**

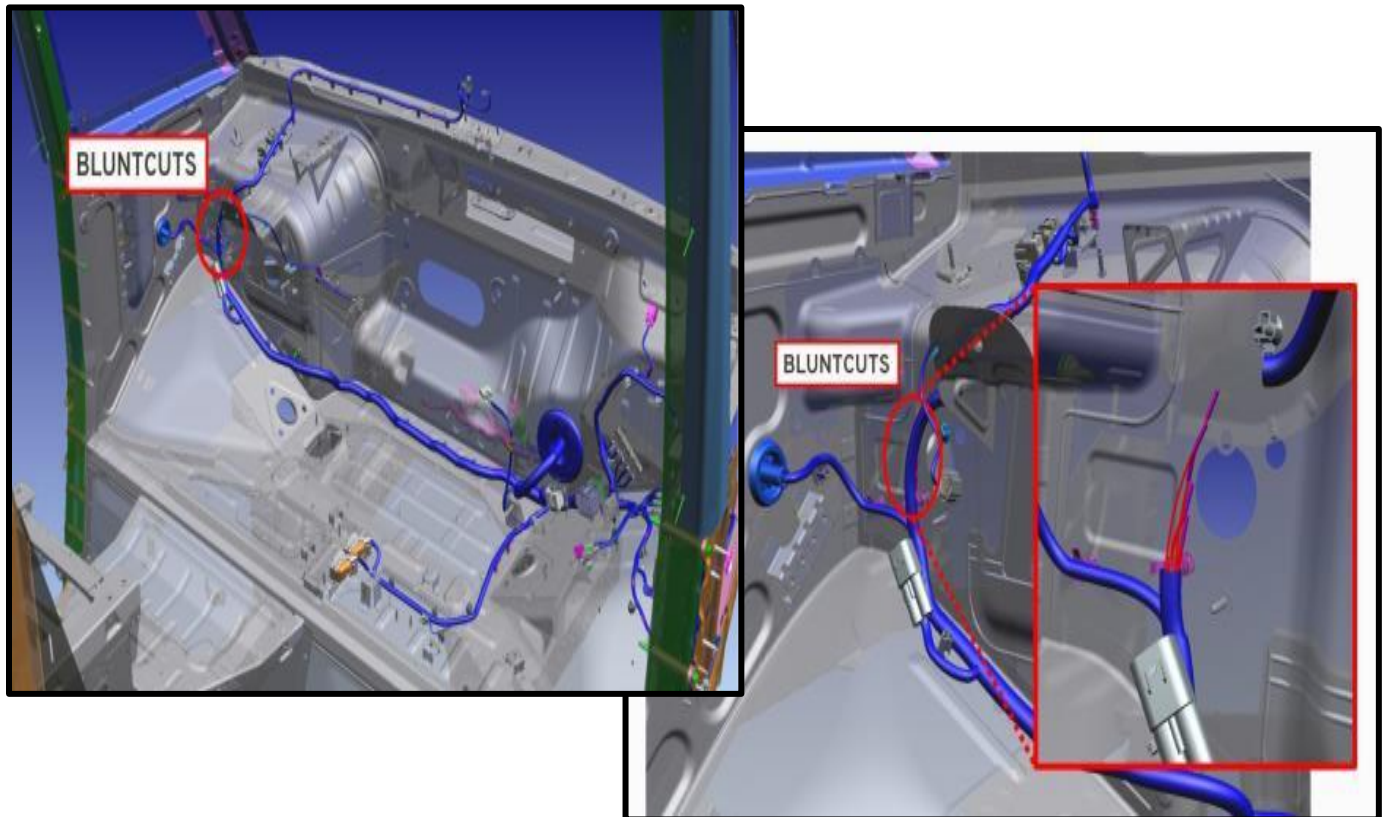

Provisional Blunt Cut Wires

Function	Wire Color	Circuit Number
10A Fused Ignition (Run Mode) Circuits	BU/VT	10721
User Utilized Relay 1	BU/WH	10716
30A Fused, relay-controlled output circuit	BU	10731
User Utilized Relay 2	VT/GY	10717
10A Fused, relay-controlled output circuit	GY/BK	10732


Upfitter Provisions (9L7)

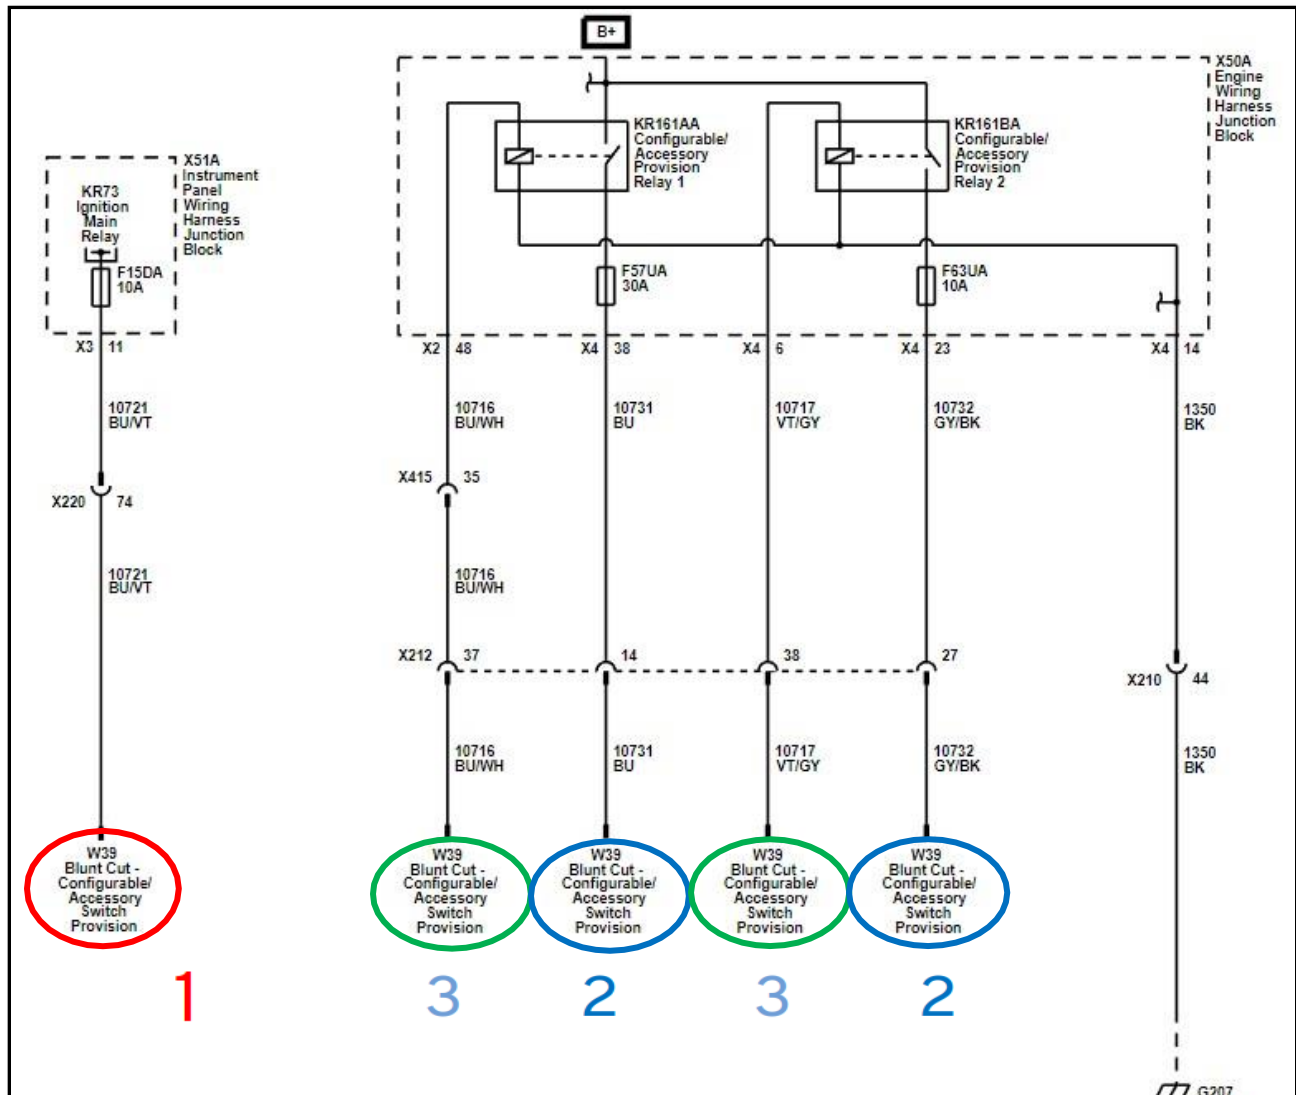

1. 10-amp fused Ignition (RUN Mode) circuit
2. Two relay-controlled output circuits (30a and 10a fused)
3. Two user utilized relay control circuits – customer/upfitter to provide V+ input for relay activation.

Schematic 'Standard Continuous'

Items in red must be added by upfitter

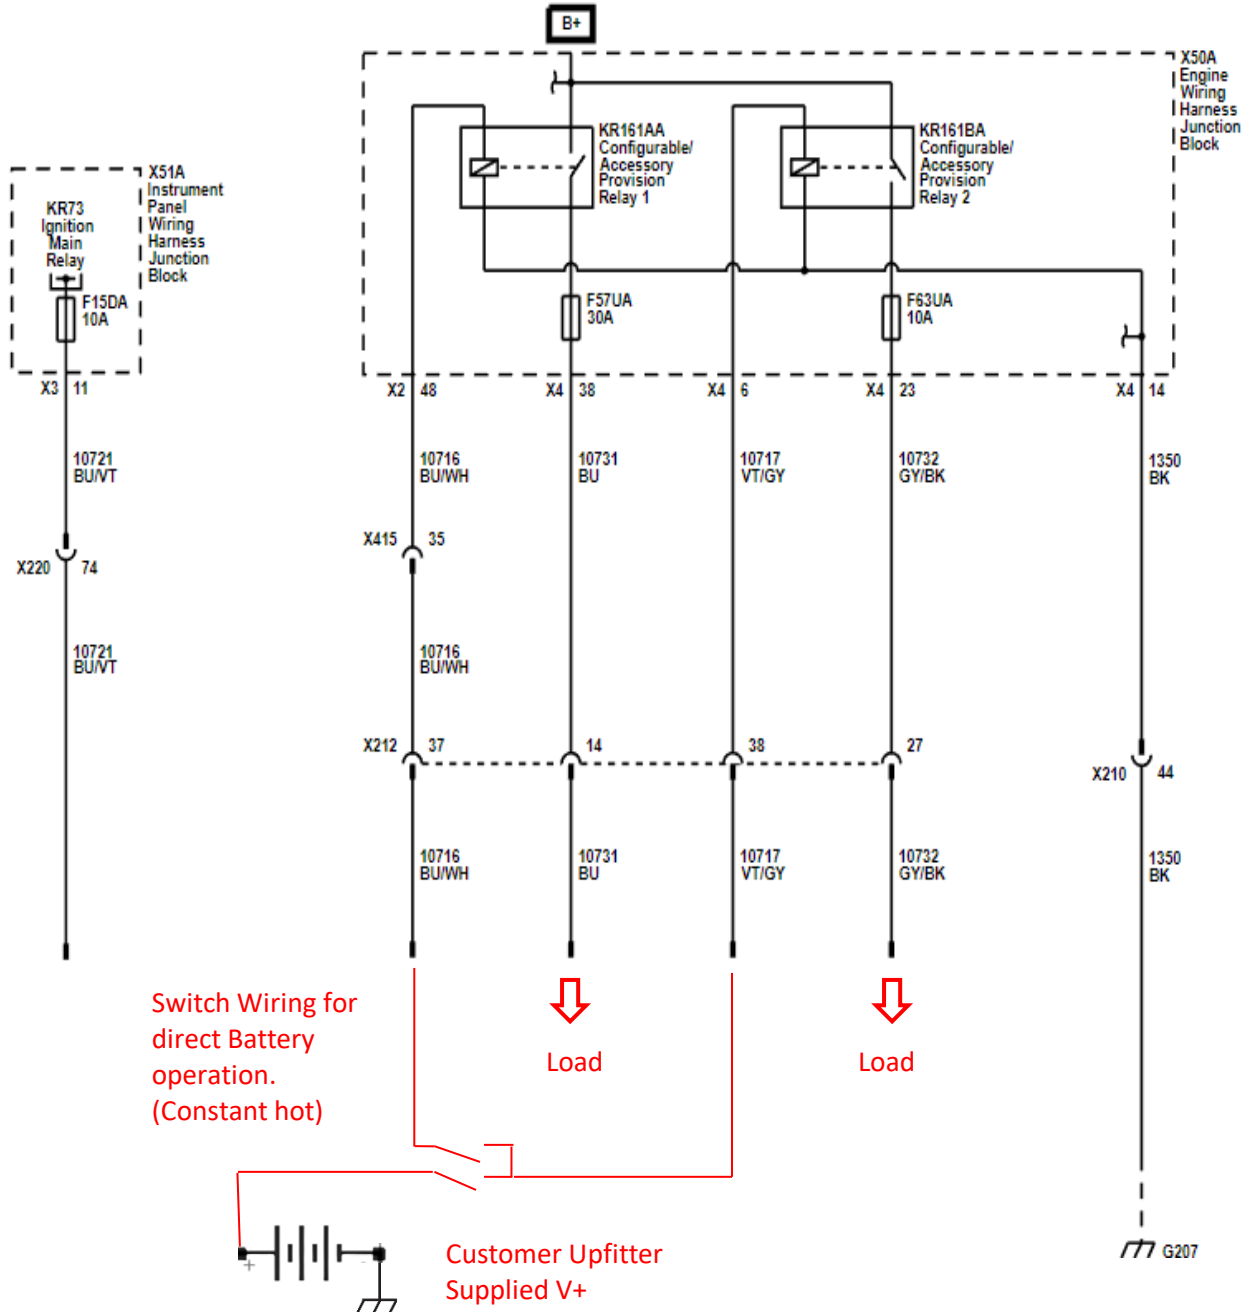

Switch Wiring for direct Battery operation. (Constant hot)

Load

Load

Customer Upfitter Supplied V+

Schematic – Ignition Controlled (Run mode)

Items in red must be added by upfitter

